


DATE	REV. NO.	NO:	PAGE
08/01/16	0	AUG-5777	10 of 12
<b>SPECIFICATION FOR HVAC CONSTRUCTION</b>			

- B. The positive air seal condensate drain shall include a CostGard Model C30XX condensate drain kit and PVC piping as shown on the detail below.

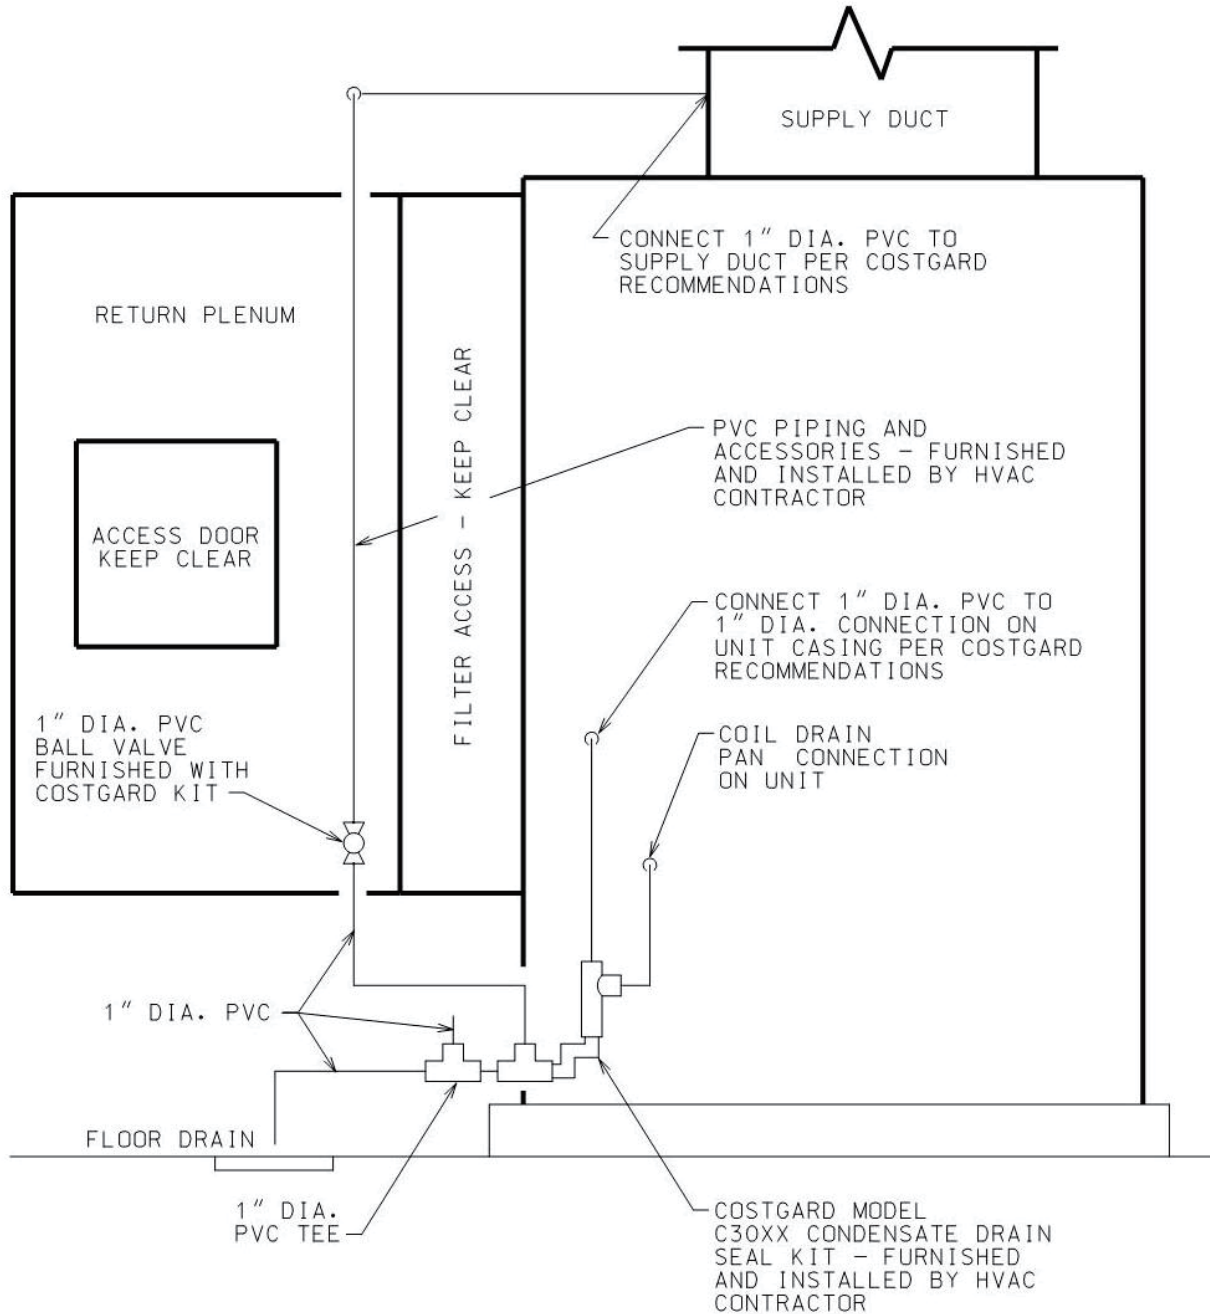

## POSITIVE SEAL CONDENSATE DRAIN DETAIL