


CostGard™ CONDENSATE DRAIN SYSTEM POSSIBLE INSTALLATION ARRANGEMENT FOR SMALL VERTICAL FLOW HVAC UNIT


CAUTION

TO PREVENT POSSIBLE DAMAGE TO INTERNAL COMPONENTS, EQUIP HOLE SAW WITH DEPTH STOP SUCH AS ILLUSTRATED BELOW.

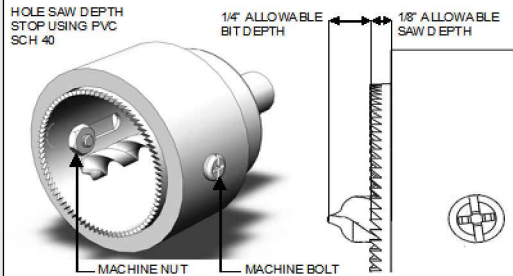

SUGGESTED HOLE SAW CONFIGURATION

NOT TO SCALE

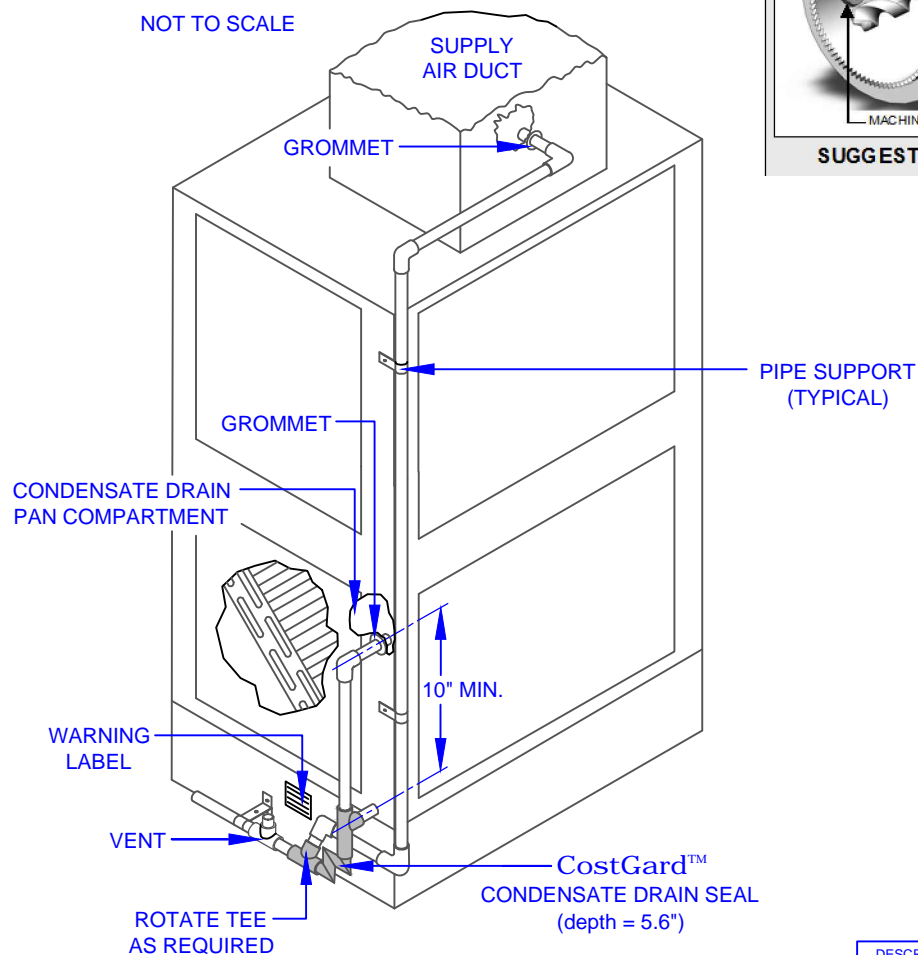

APPLICABILITY

TYPE UNIT: SPLIT
COOLING CAPACITY: UP TO 30 TONS
DRAIN DIAMETER: 3/4" AND 1"
DRAIN PAN PRESSURE: -1.5" WG OR LESS

DRAIN SYSTEM COMPONENTS

DRAIN SEAL, GROMMETS, WARNING LABEL, AND INSTALLATION INSTRUCTIONS.

FIELD SUPPLIED: PIPE, PIPE FITTINGS, AND PIPE SUPPORTS. FOR OUTDOOR INSTALLATIONS, UV INHIBITED PIPE AND PIPE FITTINGS ARE RECOMMENDED.

NOTES:

1. INSTALL PIPE SUPPORTS AS NECESSARY TO ENSURE PIPING INTEGRITY.
2. ROUTE ALL PIPING TO AVOID ACCESS PANELS.
3. MINIMUM 10" REQUIRED BETWEEN CENTERLINE OF CONDENSATE DRAIN AND WHERE THE RISER PIPE ENTERS THE CONDENSATE PAN/FAN COMPARTMENT.
4. DO NOT ALLOW RISER PIPE TO PROTRUDE THROUGH GROMMET MORE THAN 3/4".
5. CONNECTION TO SUPPLY AIR COMPARTMENT MAY VARY.
6. ALLOW 1/8" / FT. SLOPE BETWEEN CostGard™ AND FLOOR DRAIN.
7. ONCE THE COMPONENTS ARE ASSEMBLED, EACH CONNECTING JOINT MUST BE BONDED WITH PVC CEMENT.

DESCRIPTION: CostGard™ CONDENSATE DRAIN SYSTEM		
SCALE: NONE	DOCUMENT NAME: B-SVF	DATE: 3/17/14
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		SHEET: 1 OF 1

CONFIDENTIAL PROPERTY OF
Trent Technologies, Inc.
15939 OLD JACKSONVILLE HWY., TYLER, TX 75703
NOT TO BE DISCLOSED TO OTHERS, COPIED, OR
USED FOR ANY REASON EXCEPT AS AUTHORIZED.