


CAUTION

SUGGESTED HOLE SAW CONFIGURATION FOR DOUBLE WALL CONSTRUCTION

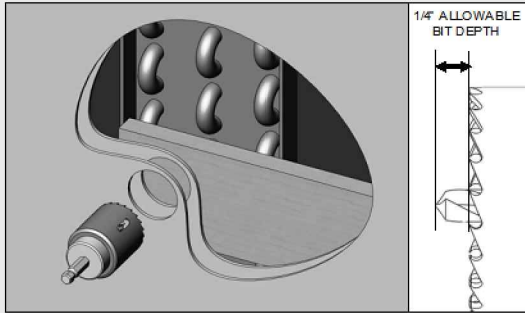

TO PREVENT POSSIBLE DAMAGE TO INTERNAL COMPONENTS:
(1) INSERT BLOCK BEHIND INSIDE PANEL; (2) BIT DEPTH LESS THAN 1/4".

NO SCALE

CostGard™ Condensate Drain Seal POSSIBLE INSTALLATION ARRANGEMENT FOR MODEL C50BV-12-11

SECTION 6

SECTION 7

SECTION 8

1-1/4" BALL VALVE INSTALLATION

Install the valve in the closed position and leave it there during the test and balancing operation. The system will drain successfully with the valve closed.

During operation at rated condition, open the valve in small steps until air begins to flow from the drain line vent. (The proper valve setting is when the air deflects slightly the flame of a lighter.)

SUPPLY AIR
PLENUM

GROMMETS (2)
(1-7/8" HOLE SAW)
DOUBLE WALL

1-1/4" PIPE
& FITTINGS

PIPE SUPPORT
(Typical)

GROMMETS (2)
(1-5/8" HOLE SAW)
DOUBLE WALL

CONDENSATE DRAIN
PAN COMPARTMENT

1" PIPE &
FITTINGS

ADAPTER
(1-1/4" FPT - SOCKET)

CostGard™
CONDENSATE DRAIN SEAL
MODEL C50BV-12-11

VENT - 3" HIGH

PIPE TO MAIN DRAIN

PIPE SUPPORT
(Typical)

CURB

NOTES:

1. INSTALL PIPE SUPPORTS AS NECESSARY TO ENSURE PIPING INTEGRITY.
2. ROUTE ALL PIPING TO AVOID ACCESS PANELS.
3. MIN 18" REQUIRED BETWEEN CENTERLINE OF CONDENSATE DRAIN AND WHERE THE RISER PIPE ENTERS THE CONDENSATE PAN/FAN COMPARTMENT.
4. DO NOT ALLOW RISER PIPE TO PROTRUDE THROUGH GROMMET MORE THAN 3/4".
5. CONNECTION TO SUPPLY AIR COMPARTMENT MAY VARY.
6. ALLOW 1/8" / FT. SLOPE BETWEEN CostGard™ AND DRAIN.
7. ONCE THE COMPONENTS ARE ASSEMBLED, EACH CONNECTING JOINT MUST BE BONDED WITH PVC CEMENT.

CONFIDENTIAL PROPERTY OF
TRENT TECHNOLOGIES, INC., 15939 FM2493, TYLER, TEXAS 75703
NOT TO BE DISCLOSED TO OTHERS, COPIED, OR USED FOR ANY REASON
EXCEPT AS AUTHORIZED

TITLE
CostGard™ CONDENSATE DRAIN SEAL
POSSIBLE INSTALLATION ARRANGEMENT

SCALE NONE DRAWING NO.
C50BV-12-11

DATE:
3/7/14

UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES

SHEET 1 OF 1